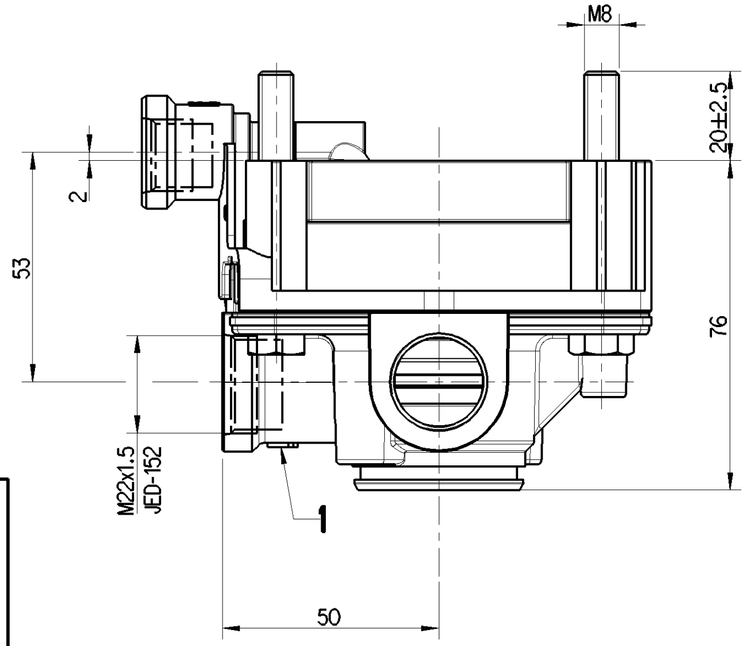

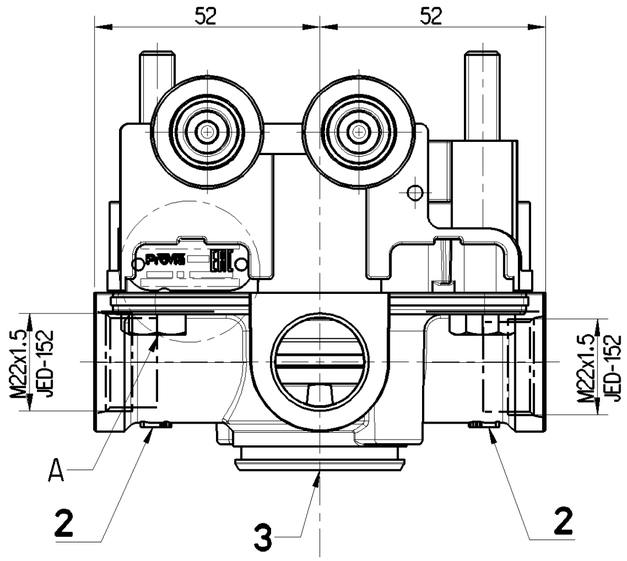

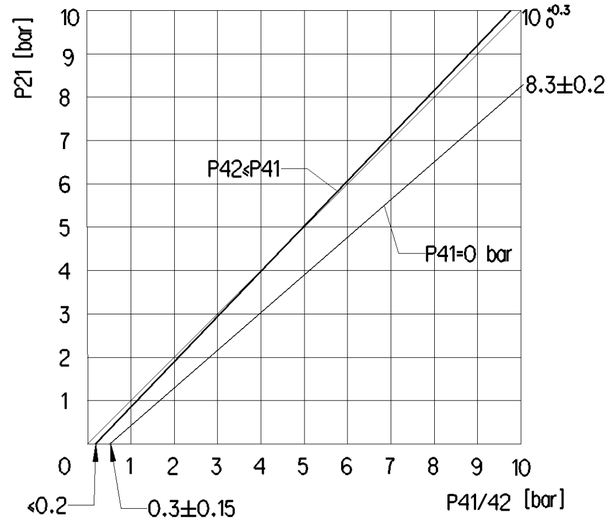

MEDIUM: AIR
MEDIUM: LUFT
FLUIDE: AIR
FLUIDO: ARIA

THERMAL RANGE OF APPLICATION :
THERMISCHER ANWENDUNGSBEREICH: -40°C...+80°C
GAMME D'APPLICATION THERMIQUE:
CAMPO TERMICO D'APPLICAZIONE :

WORKING PRESSURE :
BETRIEBSDRUCK : pe = MAX.10 bar
PRESSION D'UTILISATION:
PRESSIONE DI ESERCIZIO:

NOMINAL DIAMETER :
NENNWEITE :
DIAMETRE NOMINAL : 78 mm² = Ø10
DIAMETRO NOMINALE:

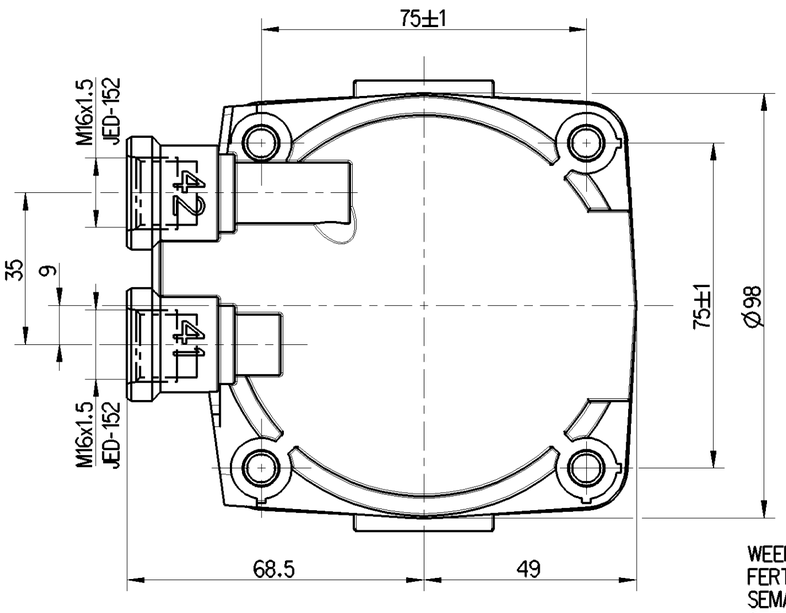

1 INLET PRESSURE
EINGESTEUERTER DRUCK
PRESSION D'ALIMENTATION
PRESSIONE DI ALIMENTAZIONE

2 OUTLET PRESSURE
AUSGESTEUERTER DRUCK
PRESSIONE DE SORTIE
PRESSION DI USCITA

3 EXHAUST
ENTLUEFTUNG
ECHAPPEMENT
SCARICO

41/42 CONTROL PRESSURE
STEUERDRUCK
PRESSION DE COMMANDE
PRESSIONE DI COMANDO

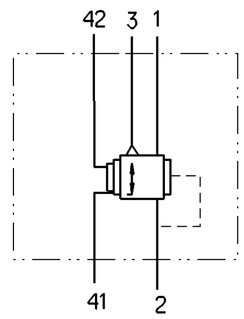

WEEK / YEAR OF MANUFACTURE
FERTIGUNGSWOCHE / -JAHR
SEMAINE / ANNEE DE FABRICATION
SETTIMANA / ANNO DELLA FABRICAZIONE

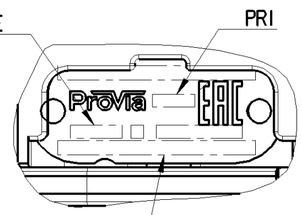

MAX.PERMISSIBLE TORQUE:
MAX.ZULAESSIGES ANZUGSMOMENT:
MAXI.COUPLE DE SERRAGE ADMISSIBLE:
MAX.COPPIA DI SERRAGGIO AMMISSIBILE:

PORT 1;2:
ANSCHLUSS 1;2:
ORIFICE 1;2:
ORIFIZIO 1;2:
53 Nm

PORT 41/42:
ANSCHLUSS 41/42:
ORIFICE 41/42:
ORIFIZIO 41/42:
34 Nm

INSTALLATION POSITION: EXHAUST FACING DOWNWARDS (AXIS CENTRE OF THE DEVICE DEVIATES MAX.90° FROM VERTICAL)

EINBAULAGE: ENTLUEFTUNG NACH UNTEN (MITTELACHSE DES GERAETES MAX. 90° VON DER SENKRECHTEN ABWEICHEND)

POSITION D'INSTALLATION: ECHAPPEMENT VERS LE BAS (ECART DE L'AXE MEDIAN DE L'APPAREIL PAR RAPPORT A LA VERTICALE: 90° MAX.)

POSIZIONE DI MONTAGGIO: SCARICO VERSO IL BASSO (DEVIAZIONE ASSE APPARECCHIO RISPETTO ALLA VERTICALE: MAX.90°)

PROVIA IDENTIFICATION NUMBER
PROVIA IDENTIFIKATIONSNUMMER
PROVIA NUMERO D'IDENTIFICATION
PROVIA NUMERO D'IDENTIFICAZIONE

A
2:1

General Specification: JED-334-1 , Size ISO 14405 LP						
Further Technical Data: Product Specification						
Doc. Code: 035			Sheet: 1 To 5			
General Tolerances JED-261						
Class 1)		Range of Nominal Dimensions (± mm) ≤ 50	> 50 ≤ 180	> 180 ≤ 400	> 400	
Fine		0.5	1.0	1.5	2.0	
Medium	X	1.0	2.0	3.0	4.0	±3°
Coarse		2.0	3.5	5.0	6.5	
Tapped Holes acc. JED-152						
1) Tolerance Class Applied Crossmarked						

Copyright WABCO®

Date	Signature
Drawn 2019-08-07	Pawlowski
Checked 2019-08-07	Kolkowski
Expert Pawlowski	

ProVia

RELAY VALVE
RELAISVENTIL
VALVE RELAIS
VALVOLA RELE

Mass	Scale	Material No.	Date of first issue: 2019-08-07		
0.758 KG	1:1 (2:1)	PRO 643 003 0	Doc.Code	Language	Sheet
			005	ML	1/1
Size	CAD System				
A 2	CREO				

ECN-No.	Revision	Techn. Resp.	Replacement for
-	- -	5220_AM	-

100mm

Toute Communication ou reproduction de ce document, toute exploitation ou communication de son contenu sont interdites, sauf autorisation expresse. Tout manquement à cette règle constitue un abus évident et expose son auteur au versement de dommages et interets. Tous droits de propriete industrielle reservés, notamment en matiere de brevets et de modèles.

Weitergabe sowie Vervielfaeltigung dieser Unterlage, Verwertung und Mitteilung ihres Inhalts nicht gestattet, soweit nicht ausdrücklich zugestanden. Zuwiderhandlungen stehen einem offensichtlichen Missbrauch dar und verpflichten zu Schadenersatz. Alle Rechte fuer den Fall der Patenterteilung oder Gebrauchsmuster-Eintragung vorbehalten.

Non è permesso consegnare a terzi o riprodurre questo documento, ne utilizzarne il contenuto o renderlo comunque noto a terzi senza autorizzazione esplicita. Ogni infrazione costituirà un evidente abuso e comporterà il risarcimento dei danni subiti. E' fatta riserva di tutti i diritti derivanti da brevetti o modelli.

Copying of this document and giving it to others and the use or communication of the contents thereof, are forbidden without express authority. Contravention of this restriction will constitute an evident abuse and result in a liability to the payment of damages. All rights are reserved in the event of the grant of patent or registration of a utility model or design. This document is the subject of copyright.